



WEIGHT (LBS)	INDUCTANCE	LOSS (WATTS)
26	0.5 mH	67


ECO No	DESCRIPTION	REV BY	DATE
M11699	UPDATED DRAWING / CHANGED SHEET FORMAT	JD	04/08/19

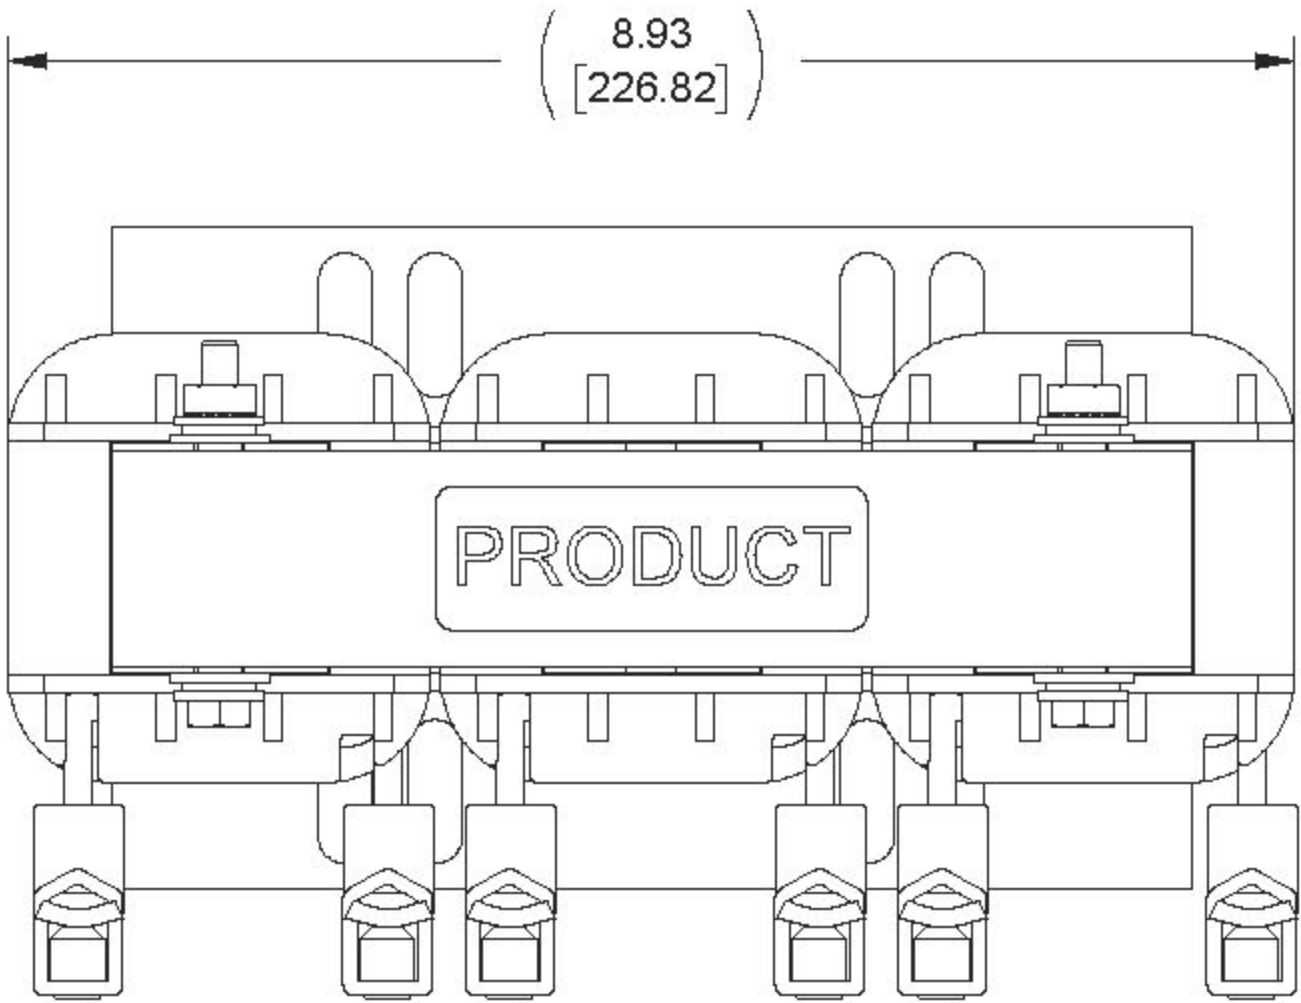


TOP VIEW

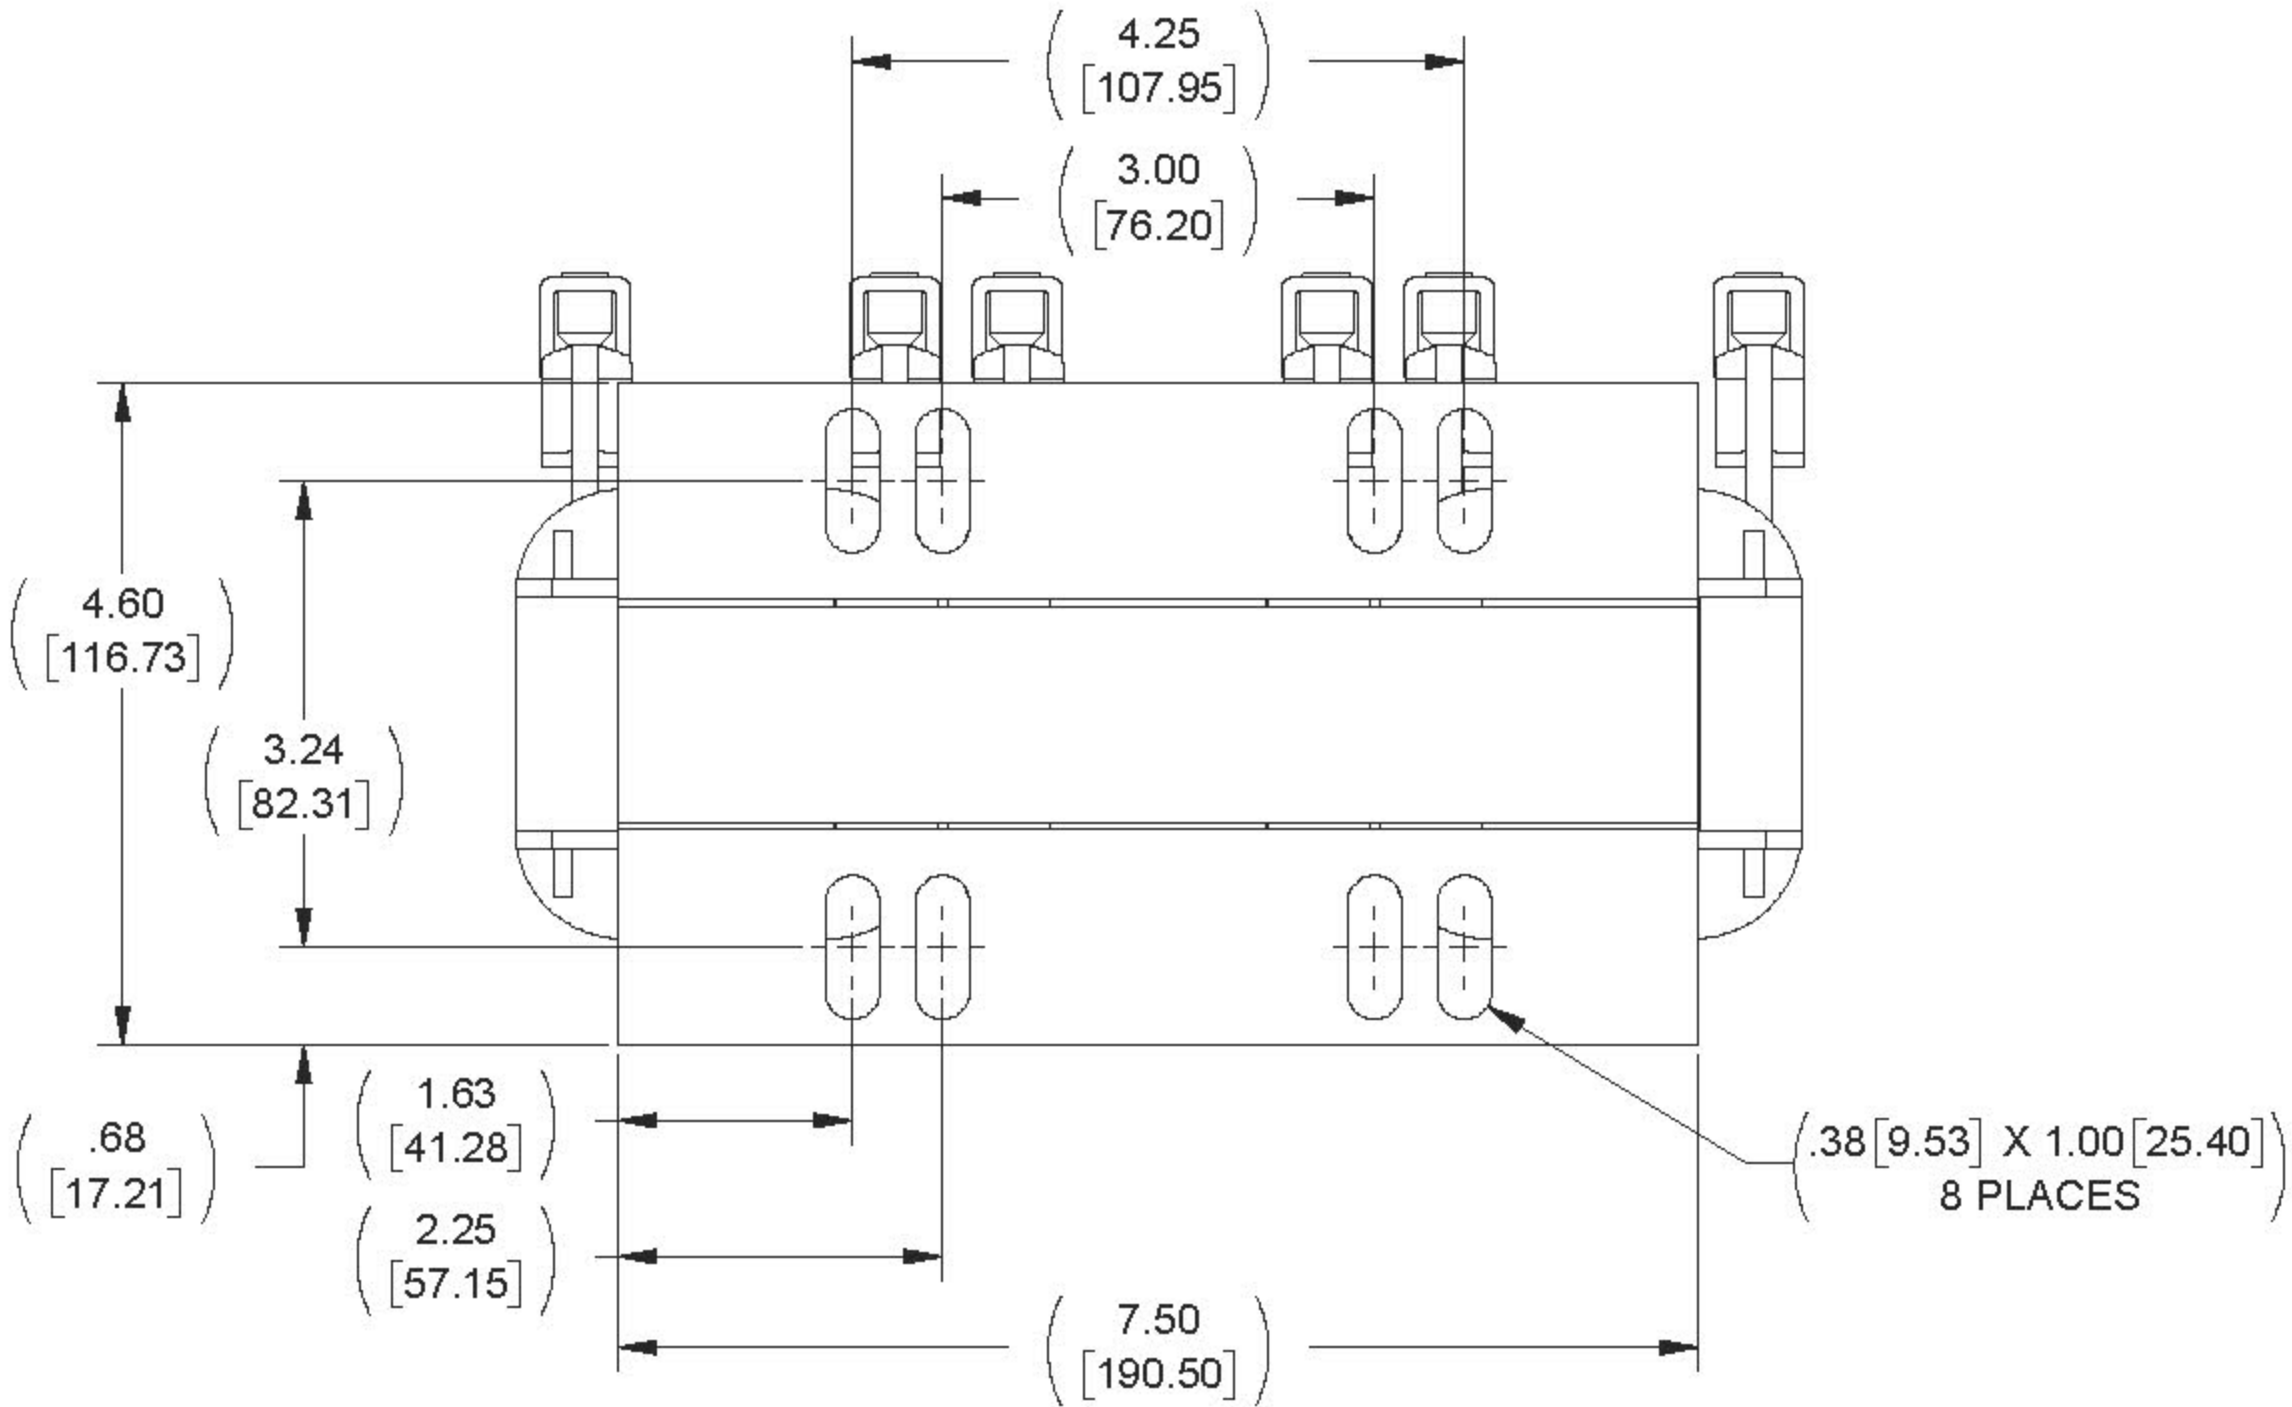


BOTTOM VIEW

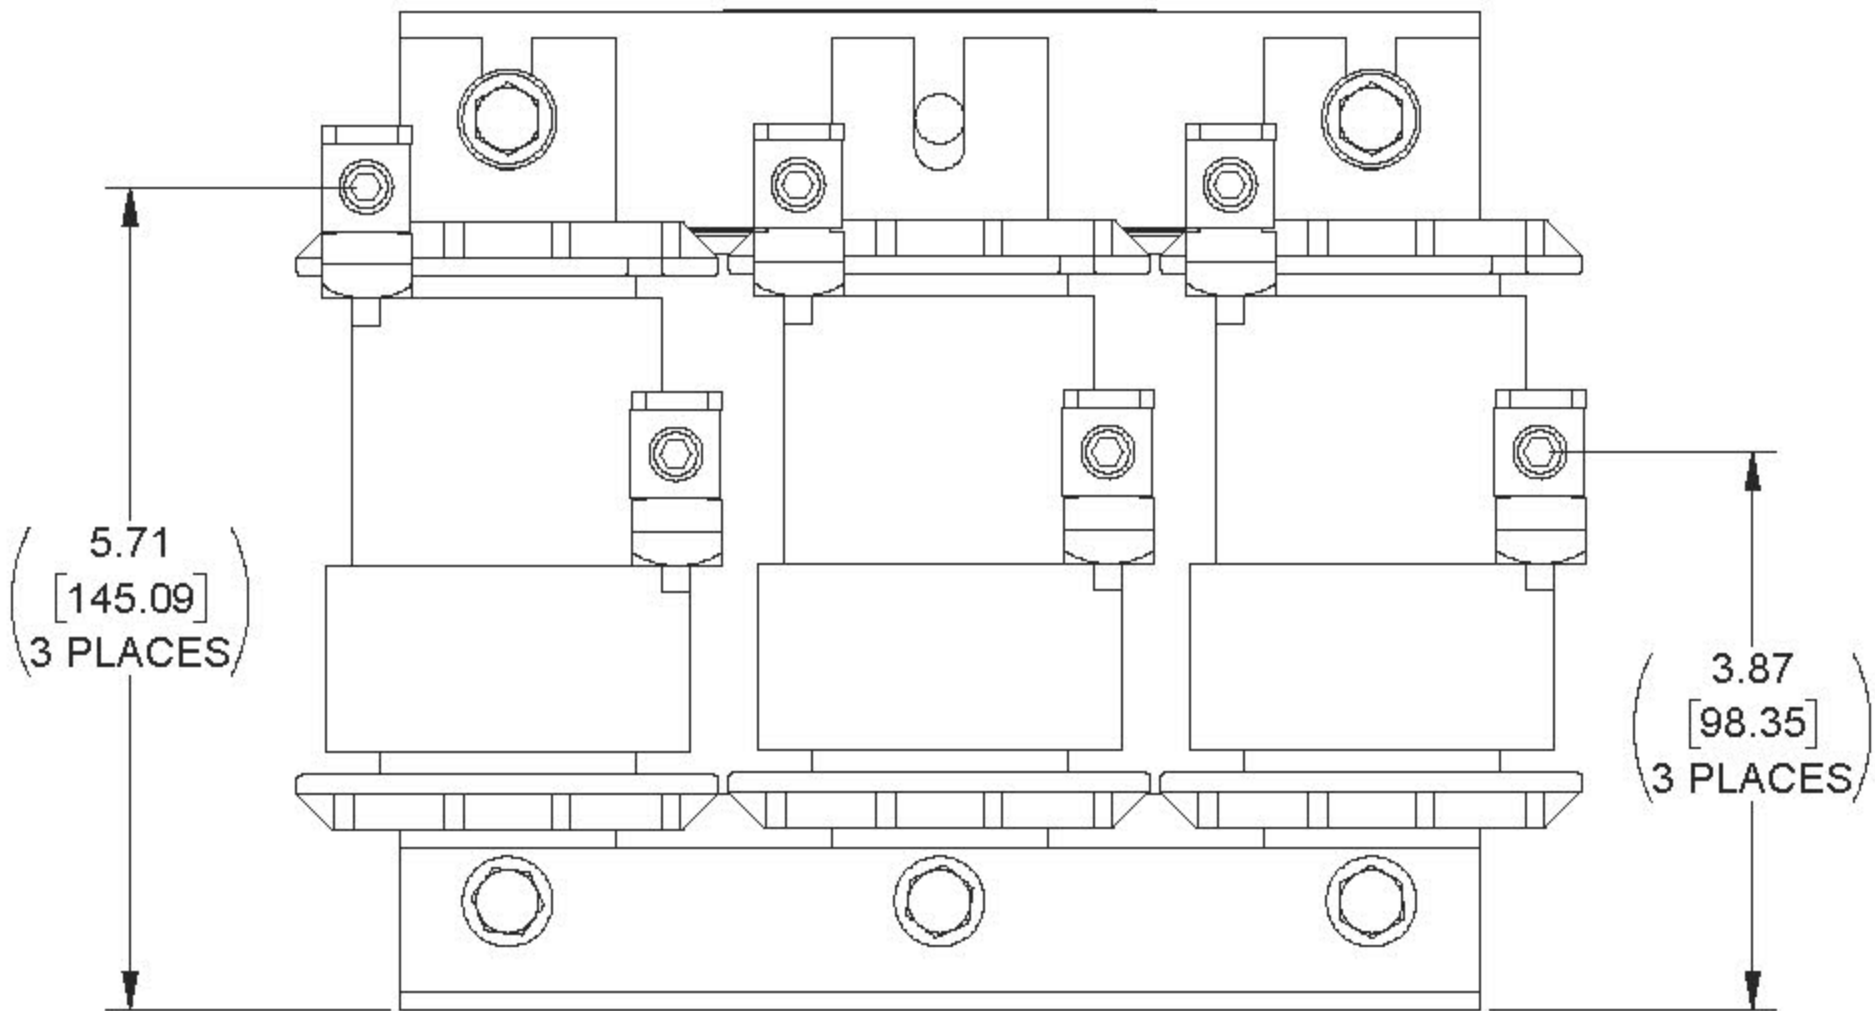

FRONT VIEW

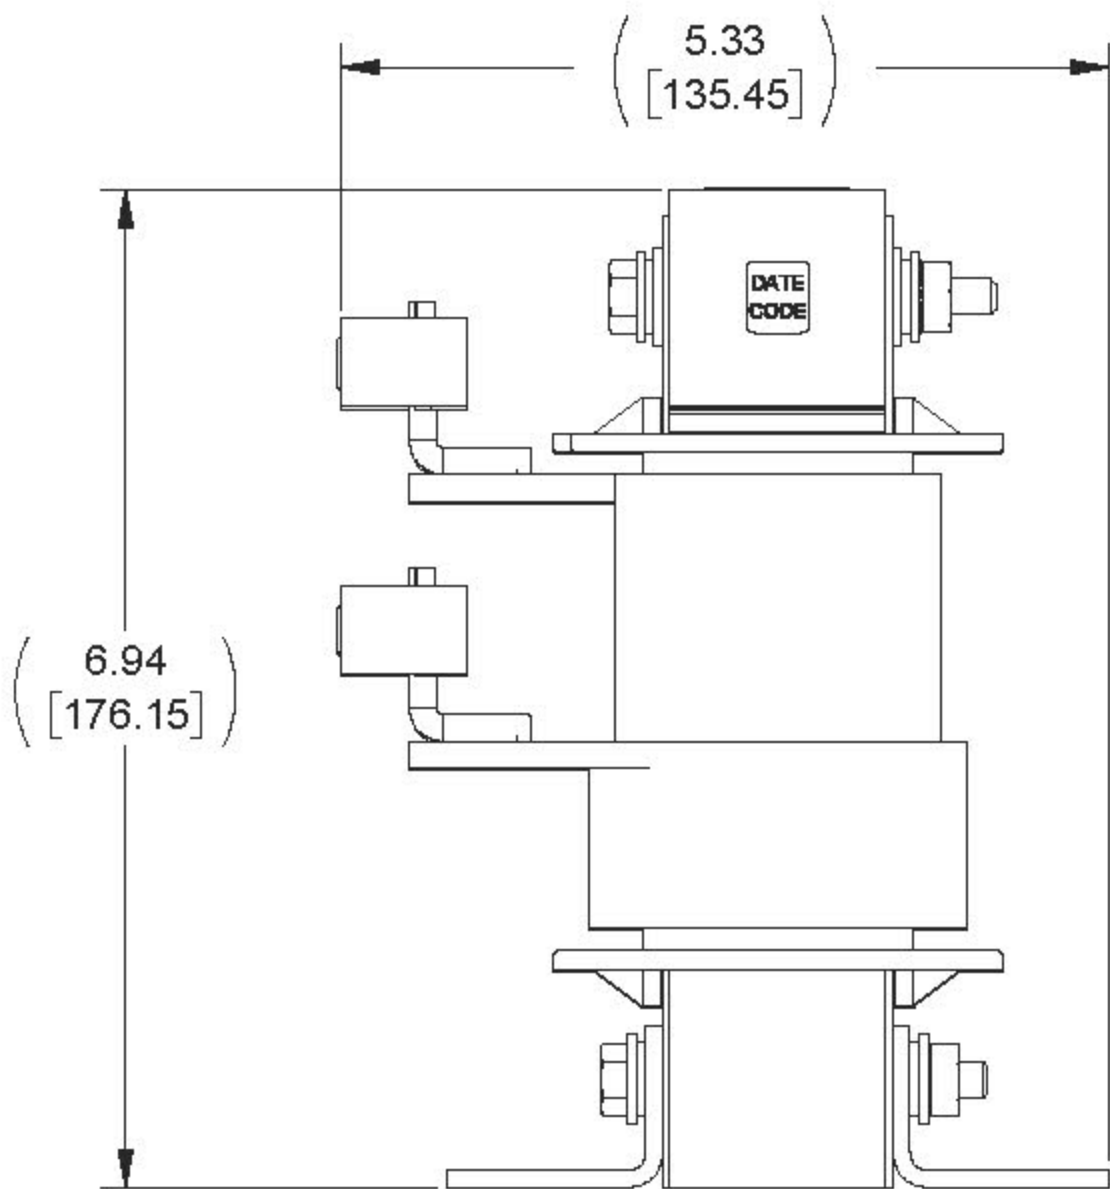

SIDE VIEW

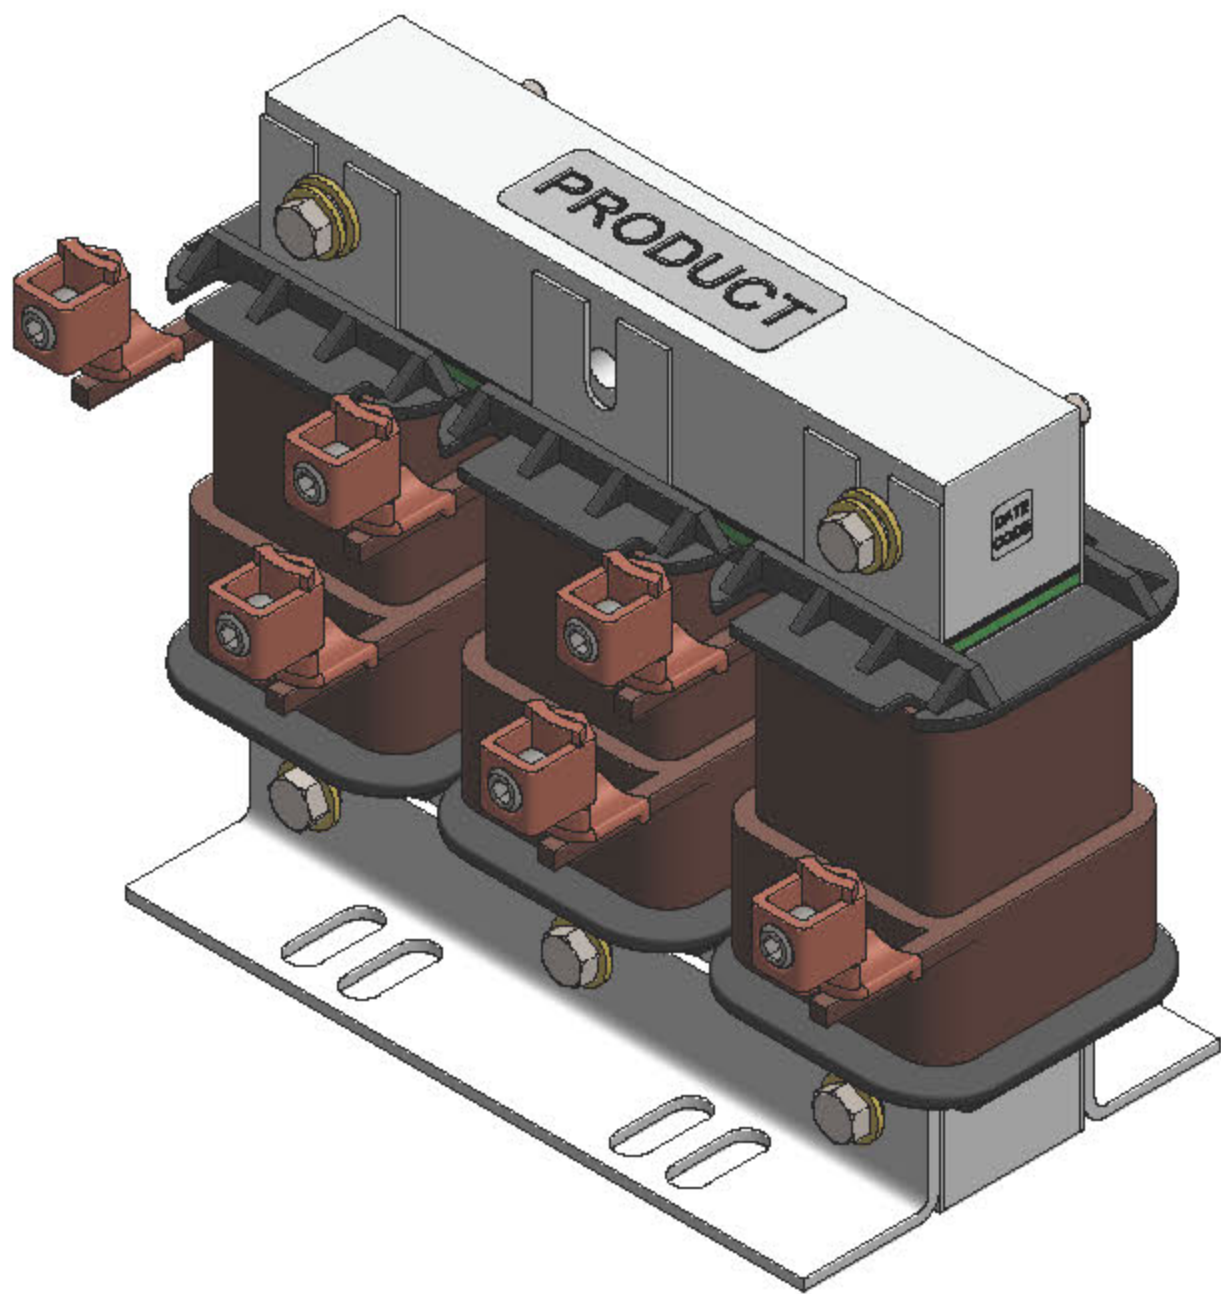

NOTES:

1. TERMINAL WIRE RANGE: 6-0 AWG
2. TERMINAL SCREW TORQUE: 6-4 (45 IN-LBS)
2-0 (50 IN-LBS)
3. REFER TO USER MANUAL FOR COMPLETE INSTALLATION INSTRUCTIONS.

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION			
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION			
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		 POWER QUALITY. SOLVED. N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455.4693 262.253.8200		LINE/LOAD REACTOR			
		DRAWN	DATE	SIZE		DWG No.	REV
		RD	4/27/94	D		CD RL-05502	20
		CHECKED	DATE	SCALE			
		JD	04/08/19	3:4			
		APPROVED	DATE				
		AK	04/10/19	SHEET 1 OF 1			