



WEIGHT (LBS)	INDUCTANCE	LOSS (WATTS)
13	0.71mH	103


ECO No	DESCRIPTION	REV BY	DATE
M11352	UPDATED COIL GRAPHICS	CR	11/06/18

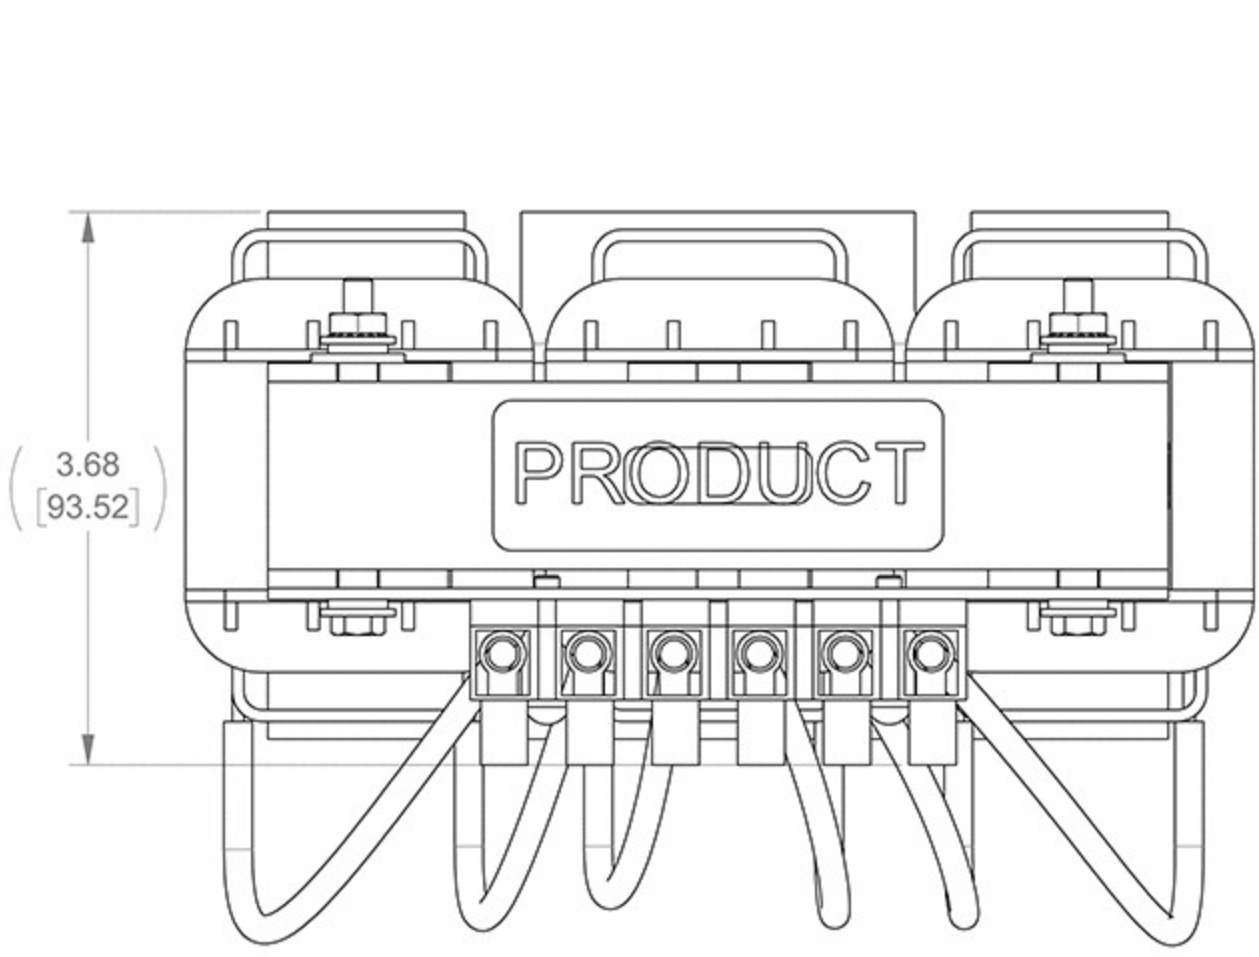


TOP VIEW

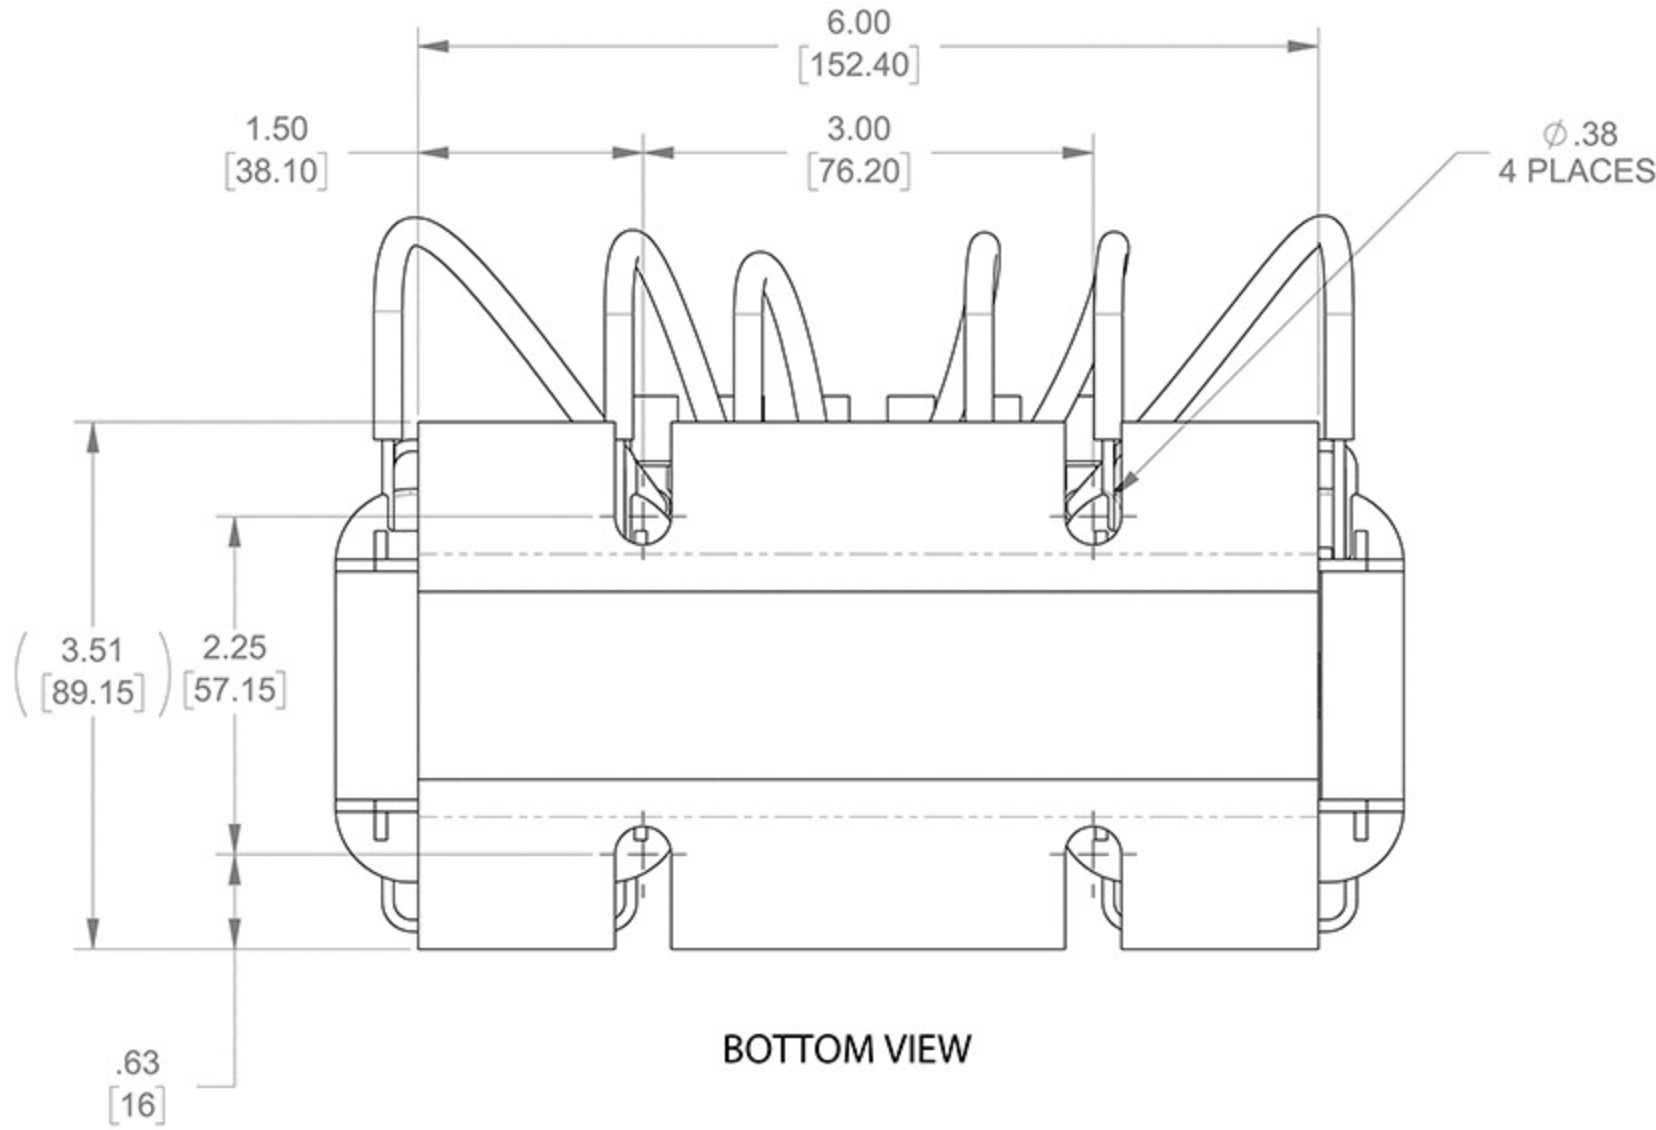

BOTTOM VIEW

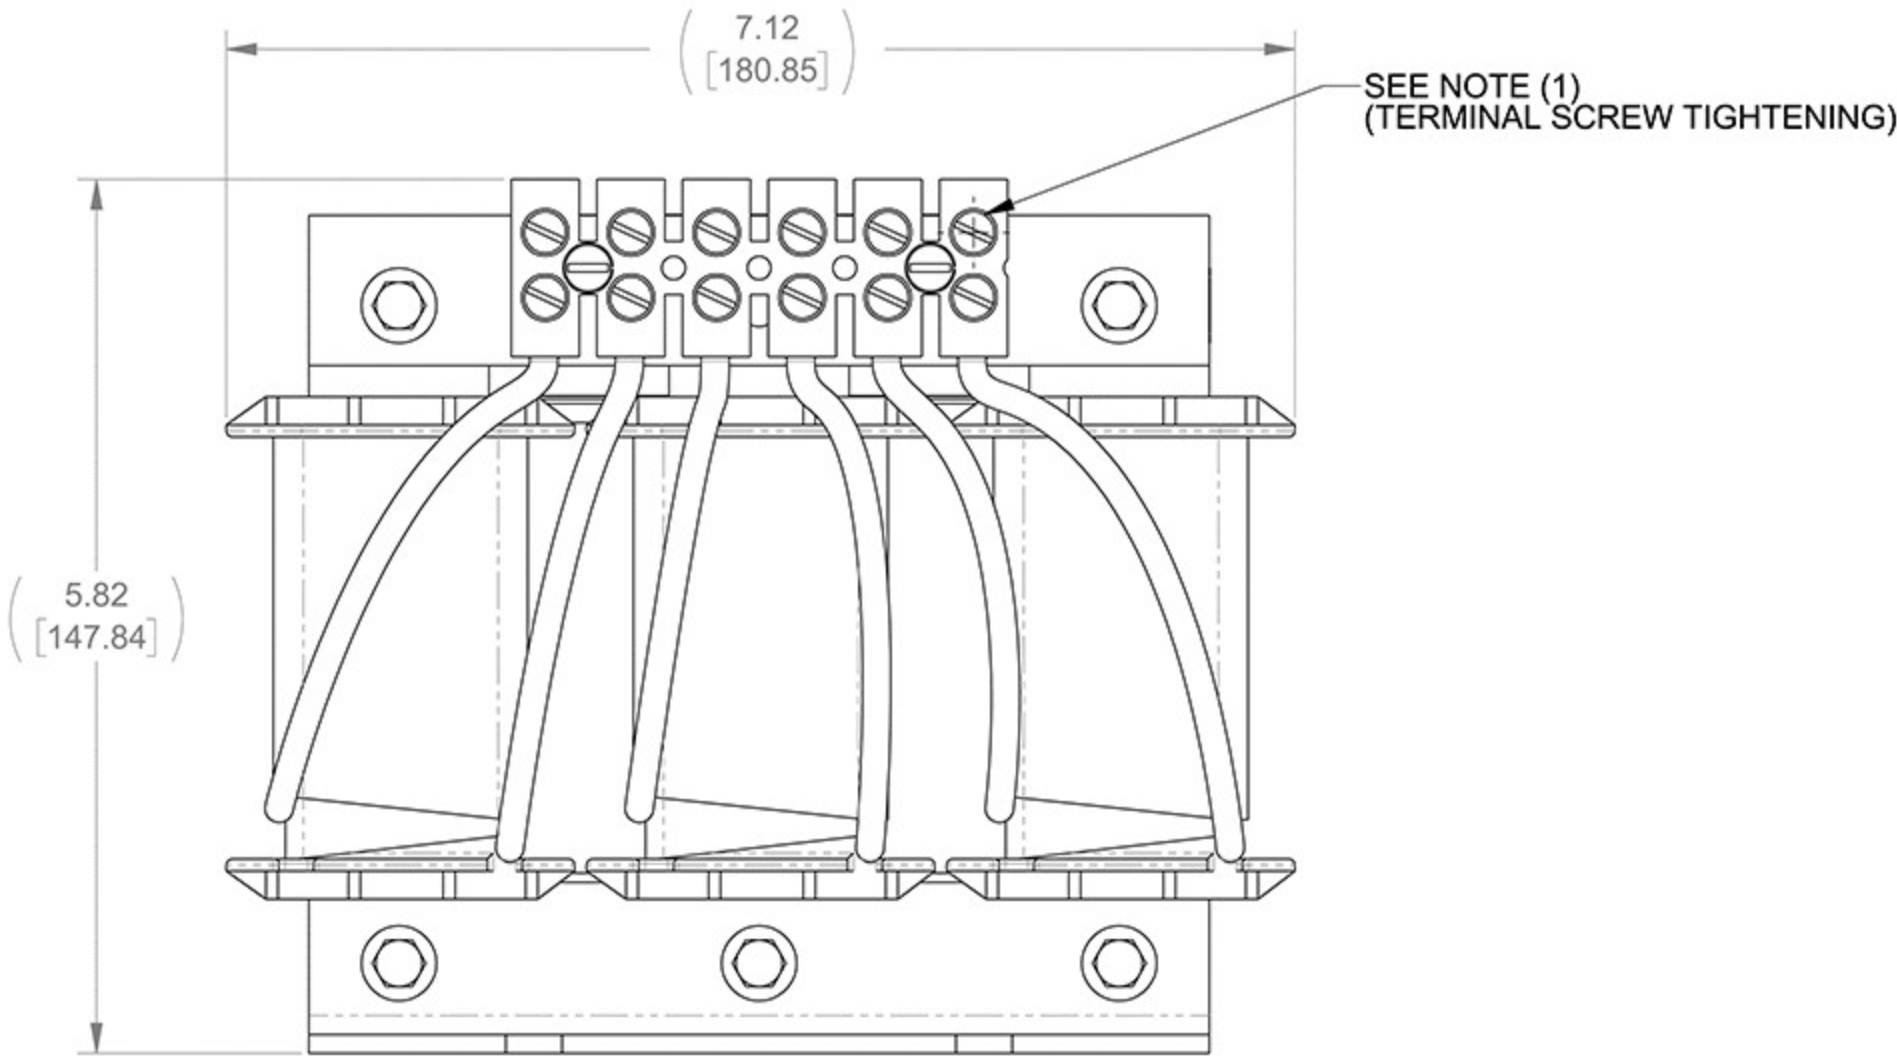

FRONT VIEW

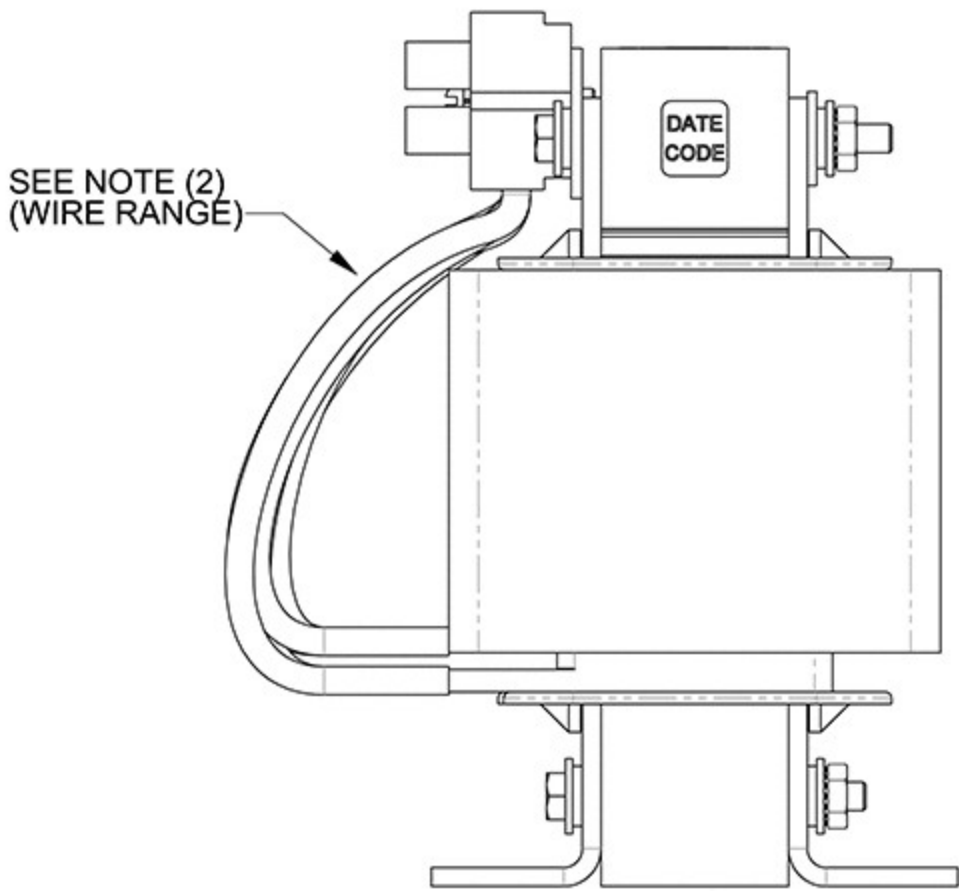

SIDE VIEW

- NOTES:
1. TERMINAL SCREW TIGHTENING TORQUE: 16 in-lbs MAX
 2. WIRE RANGE: 14 - 6 AWG

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION	
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES (MM) TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		MTE POWER QUALITY. SOLVED. N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455-4683 262.253.8200		3 PHASE REACTOR	
		DRAWN JP	DATE 09/10/12	SIZE D	DWG No. CD RLW-003503
		CHECKED CR	DATE 11/06/18	REV 03	
		APPROVED JG	DATE 11/07/18	SCALE 4:4	SHEET 1 OF 1